

Dupline® Master Module Interface for Modbus-RTU Type G 3496 0005



- Interface for Modbus-RTU with the function of a slave
- Built-in normal Dupline® Channel Generator
- 128 I/O's and DC power supply on 3 wires
- 32 Analink Inputs
- RS232/RS422/RS485 port for interfacing to control system
- Multidropping of up to 16 devices on RS485
- LED-indications for supply, Dupline® carrier and Com-port TX
- Galvanically isolated Com-port supplied by internal DC/DC converter

Product Description

G 3496 0005 is designed as a cost-effective Plug & Play solution for interfacing Dupline® I/O's to control systems. It performs three functions: Dupline® channel gen-

erator, power supply synchronization (enables 3-wire system with supply) and RS232/RS422/RS485 interface.

Ordering Key

G 3496 0005 700

Type: Dupline® _____
H4-Housing _____
Combined module _____
Interface type _____
DC supply _____

Type Selection

Supply	PLC Interface Conformance	Ordering no.
20-30 VDC	Modbus-RTU, Function code 01, 02, 03, 04, 05, 06 & 16	G 3496 0005 700

Input/Output Specifications

Power output	
Output voltage	20-30 VDC (pulsating)
Output current	< 3.0 A @ 50°C
Short circuit protection	4 A quick acting fuse
Output voltage drop	< 1.0 V
Dupline® carrier	
Output voltage	8.2 V (pulsating)
Current	< 60 mA
Short circuit protection	Yes
Scan time	
128 channels	132.2 ms
64 channels	69.8 ms
Communication port	
Standard	RS 232/RS 422/ RS 485
Split I/O / Normal mode	Normal mode
Connection	9 pole female SUB-D
Dielectric voltage	
Com-port - Dupline®	1 kVAC (rms)
Protocol	Modbus-RTU
Baud rate	9600
Data bits	8
Start bit	-
Stop bit	1
Parity	None
Flow-control	None

Input/Output Specifications (Cont.)

Pin assignment	
2-wire RS 485	
S/R Data line + (B)	Pin 3
S/R Data line - (A)	Pin 8
GND	Pin 5
4-wire RS 485/RS 422	
R Data line + (B)	Pin 3
R Data line - (A)	Pin 8
S Data line + (B)	Pin 2
S Data line - (A)	Pin 7
Direction	Pin 4
	(Connect to GND pin 5 when using 4-wire communication)
RS 232	
TX	Pin 1
RX	Pin 9
GND	Pin 5

Supply Specifications

Power supply	Overvoltage cat. III (IEC 60664)
Operational voltage (V_{in})	20-30 VDC
Reverse polarity protection	None
Current consumption	< 150 mA + Power load
Power dissipation	< 5 W
Transient protection voltage	800 V
Dielectric voltage	
Supply - Dupline®	None
Supply - com-port	1 kVAC (rms)

General Specifications

Power ON delay	2 s	Humidity (non-condensing)	20 to 80%
Indication for		Mechanical resistance	
Com-port Tx	LED, red	Shock	15 G (11 ms)
Supply ON	LED, green	Vibration	2 G (6 to 55 Hz)
Dupline® carrier	LED, yellow	Dimensions	H4-Housing
Environment		Material	(see Technical information)
Pollution degree	3 (IEC 60664)	Weight	100 g
Operating temperature	0° to +50°C (+32° to +122°F)		
Storage temperature	-50° to +85°C (-58° to +185°F)		

Mode of Operation

The Dupline® Master Module is a Dupline® Channel Generator with the function of a slave. This means that the 128 Dupline® I/O's can be read/controlled by a PC/PLC or a Control board master from many different suppliers. Up to

16 Dupline® DMM can be connected to the same network and operate together with other modules using the same protocol like operator panels, MMI's frequency inverters, I/O-modules etc.


Dip-Switch Setting

- Sw.1-4 On/Off:** Device no. 1-16 (all off = 16)
- Sw.5 On:** 64 Dupline® channels
- Sw.5 Off:** 128 Dupline® channels
- Sw.6 On:** Maintain data to Dupline® receivers in case of communication failure
- Sw.6 Off:** Clear data to Dupline® receivers in case of communication failure after 75 Dupline scans



Device no.	Sw1	Sw2	Sw3	Sw4
01	0	0	0	1
02	0	0	1	0
03	0	0	1	1
04	0	0	1	0
-				
15	1	1	1	1
16	0	0	0	0

Wiring Diagrams

Multidrop

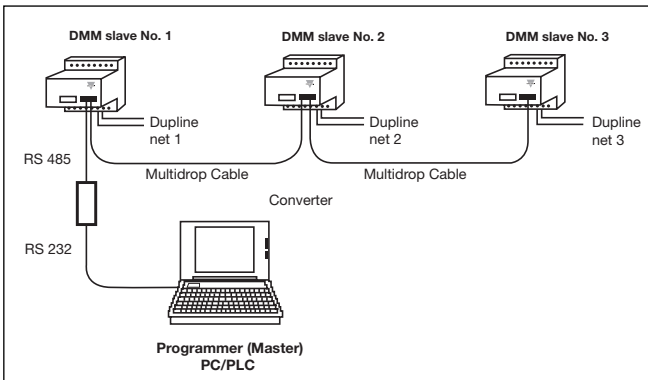

Peer to Peer

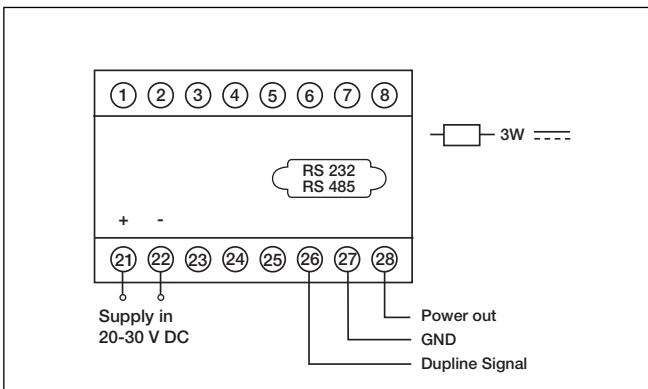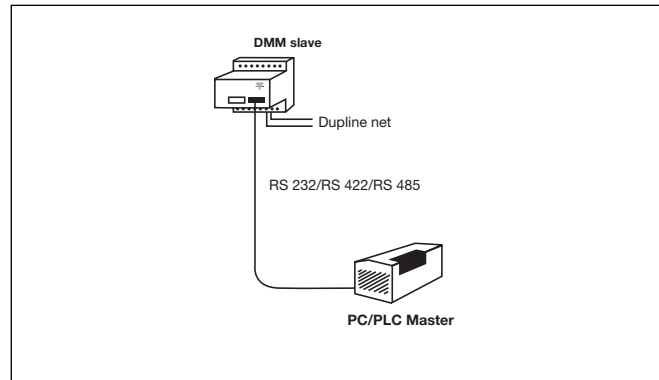

Telegram Structure

Modbus-RTU Function code 01: Read Output Table (Data to receivers) or 02: Read Input Table (Data from transmitters)

Field Name	Example (HEX)	Description
Slave Address	07	Addressed to DMM no. 7
Function	01/02	Read Output/Input Table
Starting Point no. Hi	00	Read Dupline® A6
Starting Point no. Lo	05*	(Point no. 6)
Number of points	00	Always 00 01
Number of points	01	
Error Check	XX XX	-

Response Message

Field Name	Example (HEX)	Description
Slave Address	07	Addressed from DMM no. 7
Function	01/02	Read Output/Input Table
Byte Count	01	1 byte
Data	01	Dupline® Channel A6 (ON)
Error Check	XX XX	-

Modbus-RTU Function Code 03: Read Holding Registers Query message

Field Name	Example (HEX)	Description
Slave Address	07	Addressed to DMM no. 7
Function	03	Read Registers
Starting Address Hi	00	Starting register no. 0
Starting Address Lo	00*	
Number of registers Hi	00	Read 5 Registers (Group A-J)
Number of registers Lo	05	
Error Check	XX XX	-

Response Message

Field Name	Example (HEX)	Description
Slave Address	07	Addressed from DMM no. 7
Function	03	Read Registers
Byte Count	0A	10 bytes (5 Registers)
Data Hi Register no. 1	00	Dupline® Group B
Data Lo Register no. 1	40	Dupline® Group A (A7 ON)

Data Hi Register no. 5	00	Dupline® Group J
Data Lo Register no. 5	00	Dupline® Group I
Error Check	XX XX	-

Modbus-RTU Function Code 16: Write Multiple Registers Query Message

Field Name	Example (HEX)	Description
Slave Address	07	Addressed to DMM no. 7
Function	10	Write Registers
Starting Address Hi	00	Starting Register no. 0
Starting Address Lo	00*	
Number of registers Hi	00	Write 5 Registers (Group A-J)
Number of registers Lo	05	
Byte Count	0A	10 bytes (5 Registers)
Data Hi Register 1	02	Dupline® Group B (B2 ON)
Data Lo Register 1	00	Dupline® Group A

Data Hi Register 5	00	Dupline® Group J
Data Lo Register 5	00	Dupline® Group I
Error Check	XX XX	-

Response Message

Field Name	Example (HEX)	Description
Slave Address	07	Addressed from DMM no. 7
Function	10	Write Registers
Starting Address Hi	00	Starting register no. 0
Starting Address Lo	00*	
Number of registers Hi	00	Write 5 Registers (Group A-J)
Number of registers Lo	05	
Error Check	XX XX	-

* According to modbus protocol definition the starting address/point is transferred as one less than the number of the first reg/point to be read/written to

Memory Mapping

Read Output Table (01). Read Input Table (02) and Force Single Output (05)

Point no.	Dupline® Channel
1	A1
2	A2
3	A3
-	-
128	P8

Digital read (Modbus Function 03) and Digital Write (Modbus Function 16)

Reg. no.	HIGH BYTE								LSB	LOW BYTE								LSB
	MSB	B8	B7	B6	B5	B4	B3	B2		B1	MSB	A8	A7	A6	A5	A4	A3	
1	B8	B7	B6	B5	B4	B3	B2	B1	B1	A8	A7	A6	A5	A4	A3	A2	A1	A1
2	D8	D7	D6	D5	D4	D3	D2	D1	D1	C8	C7	C6	C5	C4	C3	C2	C1	C1
3	F8	F7	F6	F5	F4	F3	F2	F1	F1	E8	E7	E6	E5	E4	E3	E2	E1	E1
4	H8	H7	H6	H5	H4	H3	H2	H1	H1	G8	G7	G6	G5	G4	G3	G2	G1	G1
5	J8	J7	J6	J5	J4	J3	J2	J1	J1	I8	I7	I6	I5	I4	I3	I2	I1	I1
6	L8	L7	L6	L5	L4	L3	L2	L1	L1	K8	K7	K6	K5	K4	K3	K2	K1	K1
7	N8	N7	N6	N5	N4	N3	N2	N1	N1	M8	M7	M6	M5	M4	M3	M2	M1	M1
8	P8	P7	P6	P5	P4	P3	P2	P1	P1	O8	O7	O6	O5	O4	O3	O2	O1	O1
129										A1	A2	A3	A4	A5	A6	A7	A8	A8
130										B1	B2	B3	B4	B5	B6	B7	B8	B8
131										C1	C2	C3	C4	C5	C6	C7	C8	C8
132										D1	D2	D3	D4	D5	D6	D7	D8	D8
-										-	-	-	-	-	-	-	-	-
144										P1	P2	P3	P4	P5	P6	P7	P8	P8

Analink read (Modbus Function 03) – 32 Analink Inputs

Reg no.	MSB	HIGH BYTE	LSB	MSB	LOW BYTE	LSB
9	Analink value 0-255 from A2			Analink value 0-255 from A1		
10	Analink value 0-255 from A4			Analink value 0-255 from A3		
11	Analink value 0-255 from A6			Analink value 0-255 from A5		
12	Analink value 0-255 from A8			Analink value 0-255 from A7		
13	Analink value 0-255 from B2			Analink value 0-255 from B1		
14	Analink value 0-255 from B4			Analink value 0-255 from B3		
15	Analink value 0-255 from B6			Analink value 0-255 from B5		
16	Analink value 0-255 from B8			Analink value 0-255 from B7		
17	Analink value 0-255 from C2			Analink value 0-255 from C1		
18	Analink value 0-255 from C4			Analink value 0-255 from C3		
19	Analink value 0-255 from C6			Analink value 0-255 from C5		
20	Analink value 0-255 from C8			Analink value 0-255 from C7		
21	Analink value 0-255 from D2			Analink value 0-255 from D1		
22	Analink value 0-255 from D4			Analink value 0-255 from D3		
23	Analink value 0-255 from D6			Analink value 0-255 from D5		
24	Analink value 0-255 from D8			Analink value 0-255 from D7		
145				Analink value 0-255 from A1		
146				Analink value 0-255 from A2		
147				Analink value 0-255 from A3		
148				Analink value 0-255 from A4		
149				Analink value 0-255 from A5		
150				Analink value 0-255 from A6		
-						
175				Analink value 0-255 from P7		
176				Analink value 0-255 from P8		

Installation Hints

No TX-LED

Checksum Error

The Checksum has been calculated in a wrong way.

Wrong telegram structure

See "Telegram Structure"

Hardware fault

Check the wiring. Try to send the telegram-example mentioned in "Telegram Structure."

No Dupline® Carrier-Led

Short circuit

Short circuit between the two Dupline® wires.

Additional Information

Scope of supply

1 x Master Module

G3496 0005 700

Accessories

Support Disc

Download the Support Disc from our homepage www.dupline.com