
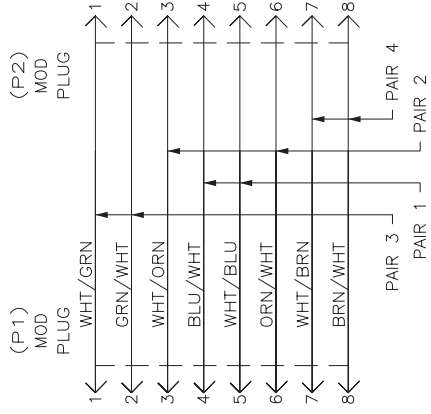


REV	DATE	DESCRIPTION
C	18OCT01	REV: EC 0B10-0184-01
D	22MAY02	REV/EC- 0B10-0086-02
E	30DEC02	REV ECN 0B10-0178-02
F	04JAN07	REV ECD-06-27719

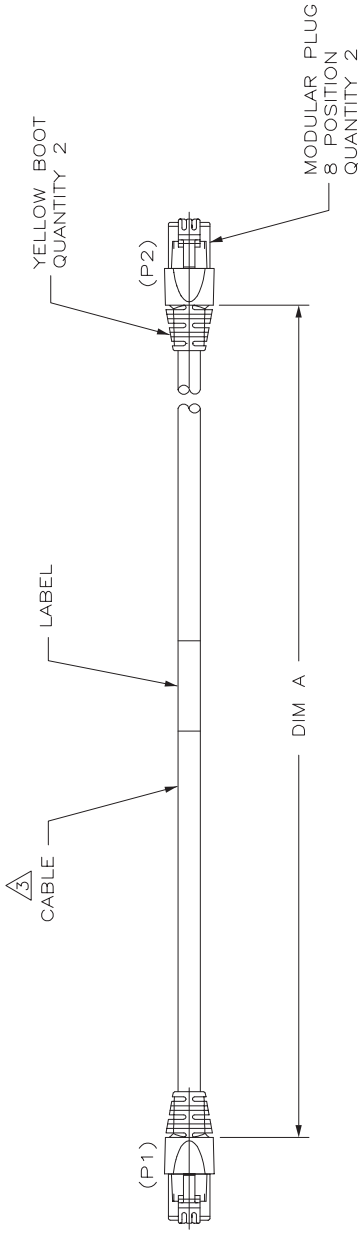

WIRING DIAGRAM 568A

- ONE CABLE PACKAGED IN A CLEAR POLYBAG.
- DIMENSIONS ARE MAXIMUM UNLESS OTHERWISE SPECIFIED.
- CABLE: UNSHIELDED 24 AWG, 4 TWISTED PAIRS, 7/32 STRANDED CONDUCTORS, 100 OHMS, DESIGNATIONS IN PARENTHESES () ARE FOR REFERENCE ONLY.
- AN ALTERNATE FORM OF CONNECTOR COMPONENTS RESULTING IN EQUIVALENT PERFORMANCE IS ACCEPTABLE.

METERS	REF	FEET	REF	DIM A	PART NO
0.15	0.5	203.2	(8.00)	9-219246-8	
15.24	50	15392.4	(606.00)	5-219246-0	
12.20	40	12344.4	(486.00)	4-219246-0	
9.15	30	9296.4	(366.00)	3-219246-0	
7.62	25	7721.6	(304.00)	2-219246-5	
6.71	22	6705.6	(268.00)	2-219246-2	
6.41	21	6502.4	(256.00)	2-219246-1	
6.10	20	6197.6	(244.00)	2-219246-0	
5.80	19	5892.8	(232.00)	1-219246-9	
5.49	18	5588.0	(220.00)	1-219246-8	
5.19	17	5283.2	(208.00)	1-219246-7	
4.88	16	4978.4	(196.00)	1-219246-6	
4.57	15	4724.4	(184.00)	1-219246-5	
4.27	14	4368.8	(172.00)	1-219246-4	
3.66	12	3759.2	(148.00)	1-219246-2	
3.05	10	3149.6	(124.00)	1-219246-0	
2.74	9	2794	(110.00)	219246-9	
2.44	8	2489.2	(98.00)	219246-8	
2.14	7	2184.4	(86.00)	219246-7	
1.83	6	1879.6	(74.00)	219246-6	
1.53	5	1574.8	(62.00)	219246-5	
1.22	4	1270	(50.00)	219246-4	
0.92	3	965.2	(38.00)	219246-3	
0.61	2	660.4	(26.00)	219246-2	
0.30	1	355.6	(14.00)	219246-1	

THIS DRAWING IS A CONTROLLED DOCUMENT.

DESIGNER: M. BOLES	25AUG97
CHK: B. ANTHONY	25AUG97
APP: B. ANTHONY	25AUG97
PRODUCT SPEC: 108-1163	
APPLICATION SPEC: 114-6053	
WEIGHT: -	
FINISH: -	

OTHERS: 0 P/LC ±, 1 P/LC ±, 2 P/LC ±, 3 P/LC ±, 4 P/LC ±, 5 P/LC ±, 6 P/LC ±, 7 P/LC ±, 8 P/LC ±, 9 P/LC ±, 10 P/LC ±, 11 P/LC ±, 12 P/LC ±, 13 P/LC ±, 14 P/LC ±, 15 P/LC ±, 16 P/LC ±, 17 P/LC ±, 18 P/LC ±, 19 P/LC ±, 20 P/LC ±, 21 P/LC ±, 22 P/LC ±, 23 P/LC ±, 24 P/LC ±, 25 P/LC ±, 26 P/LC ±, 27 P/LC ±, 28 P/LC ±, 29 P/LC ±, 30 P/LC ±, 31 P/LC ±, 32 P/LC ±, 33 P/LC ±, 34 P/LC ±, 35 P/LC ±, 36 P/LC ±, 37 P/LC ±, 38 P/LC ±, 39 P/LC ±, 40 P/LC ±, 41 P/LC ±, 42 P/LC ±, 43 P/LC ±, 44 P/LC ±, 45 P/LC ±, 46 P/LC ±, 47 P/LC ±, 48 P/LC ±, 49 P/LC ±, 50 P/LC ±, 51 P/LC ±, 52 P/LC ±, 53 P/LC ±, 54 P/LC ±, 55 P/LC ±, 56 P/LC ±, 57 P/LC ±, 58 P/LC ±, 59 P/LC ±, 60 P/LC ±, 61 P/LC ±, 62 P/LC ±, 63 P/LC ±, 64 P/LC ±, 65 P/LC ±, 66 P/LC ±, 67 P/LC ±, 68 P/LC ±, 69 P/LC ±, 70 P/LC ±, 71 P/LC ±, 72 P/LC ±, 73 P/LC ±, 74 P/LC ±, 75 P/LC ±, 76 P/LC ±, 77 P/LC ±, 78 P/LC ±, 79 P/LC ±, 80 P/LC ±, 81 P/LC ±, 82 P/LC ±, 83 P/LC ±, 84 P/LC ±, 85 P/LC ±, 86 P/LC ±, 87 P/LC ±, 88 P/LC ±, 89 P/LC ±, 90 P/LC ±, 91 P/LC ±, 92 P/LC ±, 93 P/LC ±, 94 P/LC ±, 95 P/LC ±, 96 P/LC ±, 97 P/LC ±, 98 P/LC ±, 99 P/LC ±, 100 P/LC ±, 101 P/LC ±, 102 P/LC ±, 103 P/LC ±, 104 P/LC ±, 105 P/LC ±, 106 P/LC ±, 107 P/LC ±, 108 P/LC ±, 109 P/LC ±, 110 P/LC ±, 111 P/LC ±, 112 P/LC ±, 113 P/LC ±, 114 P/LC ±, 115 P/LC ±, 116 P/LC ±, 117 P/LC ±, 118 P/LC ±, 119 P/LC ±, 120 P/LC ±, 121 P/LC ±, 122 P/LC ±, 123 P/LC ±, 124 P/LC ±, 125 P/LC ±, 126 P/LC ±, 127 P/LC ±, 128 P/LC ±, 129 P/LC ±, 130 P/LC ±, 131 P/LC ±, 132 P/LC ±, 133 P/LC ±, 134 P/LC ±, 135 P/LC ±, 136 P/LC ±, 137 P/LC ±, 138 P/LC ±, 139 P/LC ±, 140 P/LC ±, 141 P/LC ±, 142 P/LC ±, 143 P/LC ±, 144 P/LC ±, 145 P/LC ±, 146 P/LC ±, 147 P/LC ±, 148 P/LC ±, 149 P/LC ±, 150 P/LC ±, 151 P/LC ±, 152 P/LC ±, 153 P/LC ±, 154 P/LC ±, 155 P/LC ±, 156 P/LC ±, 157 P/LC ±, 158 P/LC ±, 159 P/LC ±, 160 P/LC ±, 161 P/LC ±, 162 P/LC ±, 163 P/LC ±, 164 P/LC ±, 165 P/LC ±, 166 P/LC ±, 167 P/LC ±, 168 P/LC ±, 169 P/LC ±, 170 P/LC ±, 171 P/LC ±, 172 P/LC ±, 173 P/LC ±, 174 P/LC ±, 175 P/LC ±, 176 P/LC ±, 177 P/LC ±, 178 P/LC ±, 179 P/LC ±, 180 P/LC ±, 181 P/LC ±, 182 P/LC ±, 183 P/LC ±, 184 P/LC ±, 185 P/LC ±, 186 P/LC ±, 187 P/LC ±, 188 P/LC ±, 189 P/LC ±, 190 P/LC ±, 191 P/LC ±, 192 P/LC ±, 193 P/LC ±, 194 P/LC ±, 195 P/LC ±, 196 P/LC ±, 197 P/LC ±, 198 P/LC ±, 199 P/LC ±, 200 P/LC ±, 201 P/LC ±, 202 P/LC ±, 203 P/LC ±, 204 P/LC ±, 205 P/LC ±, 206 P/LC ±, 207 P/LC ±, 208 P/LC ±, 209 P/LC ±, 210 P/LC ±, 211 P/LC ±, 212 P/LC ±, 213 P/LC ±, 214 P/LC ±, 215 P/LC ±, 216 P/LC ±, 217 P/LC ±, 218 P/LC ±, 219 P/LC ±, 220 P/LC ±, 221 P/LC ±, 222 P/LC ±, 223 P/LC ±, 224 P/LC ±, 225 P/LC ±, 226 P/LC ±, 227 P/LC ±, 228 P/LC ±, 229 P/LC ±, 230 P/LC ±, 231 P/LC ±, 232 P/LC ±, 233 P/LC ±, 234 P/LC ±, 235 P/LC ±, 236 P/LC ±, 237 P/LC ±, 238 P/LC ±, 239 P/LC ±, 240 P/LC ±, 241 P/LC ±, 242 P/LC ±, 243 P/LC ±, 244 P/LC ±, 245 P/LC ±, 246 P/LC ±, 247 P/LC ±, 248 P/LC ±, 249 P/LC ±, 250 P/LC ±, 251 P/LC ±, 252 P/LC ±, 253 P/LC ±, 254 P/LC ±, 255 P/LC ±, 256 P/LC ±, 257 P/LC ±, 258 P/LC ±, 259 P/LC ±, 260 P/LC ±, 261 P/LC ±, 262 P/LC ±, 263 P/LC ±, 264 P/LC ±, 265 P/LC ±, 266 P/LC ±, 267 P/LC ±, 268 P/LC ±, 269 P/LC ±, 270 P/LC ±, 271 P/LC ±, 272 P/LC ±, 273 P/LC ±, 274 P/LC ±, 275 P/LC ±, 276 P/LC ±, 277 P/LC ±, 278 P/LC ±, 279 P/LC ±, 280 P/LC ±, 281 P/LC ±, 282 P/LC ±, 283 P/LC ±, 284 P/LC ±, 285 P/LC ±, 286 P/LC ±, 287 P/LC ±, 288 P/LC ±, 289 P/LC ±, 290 P/LC ±, 291 P/LC ±, 292 P/LC ±, 293 P/LC ±, 294 P/LC ±, 295 P/LC ±, 296 P/LC ±, 297 P/LC ±, 298 P/LC ±, 299 P/LC ±, 300 P/LC ±, 301 P/LC ±, 302 P/LC ±, 303 P/LC ±, 304 P/LC ±, 305 P/LC ±, 306 P/LC ±, 307 P/LC ±, 308 P/LC ±, 309 P/LC ±, 310 P/LC ±, 311 P/LC ±, 312 P/LC ±, 313 P/LC ±, 314 P/LC ±, 315 P/LC ±, 316 P/LC ±, 317 P/LC ±, 318 P/LC ±, 319 P/LC ±, 320 P/LC ±, 321 P/LC ±, 322 P/LC ±, 323 P/LC ±, 324 P/LC ±, 325 P/LC ±, 326 P/LC ±, 327 P/LC ±, 328 P/LC ±, 329 P/LC ±, 330 P/LC ±, 331 P/LC ±, 332 P/LC ±, 333 P/LC ±, 334 P/LC ±, 335 P/LC ±, 336 P/LC ±, 337 P/LC ±, 338 P/LC ±, 339 P/LC ±, 340 P/LC ±, 341 P/LC ±, 342 P/LC ±, 343 P/LC ±, 344 P/LC ±, 345 P/LC ±, 346 P/LC ±, 347 P/LC ±, 348 P/LC ±, 349 P/LC ±, 350 P/LC ±, 351 P/LC ±, 352 P/LC ±, 353 P/LC ±, 354 P/LC ±, 355 P/LC ±, 356 P/LC ±, 357 P/LC ±, 358 P/LC ±, 359 P/LC ±, 360 P/LC ±, 361 P/LC ±, 362 P/LC ±, 363 P/LC ±, 364 P/LC ±, 365 P/LC ±, 366 P/LC ±, 367 P/LC ±, 368 P/LC ±, 369 P/LC ±, 370 P/LC ±, 371 P/LC ±, 372 P/LC ±, 373 P/LC ±, 374 P/LC ±, 375 P/LC ±, 376 P/LC ±, 377 P/LC ±, 378 P/LC ±, 379 P/LC ±, 380 P/LC ±, 381 P/LC ±, 382 P/LC ±, 383 P/LC ±, 384 P/LC ±, 385 P/LC ±, 386 P/LC ±, 387 P/LC ±, 388 P/LC ±, 389 P/LC ±, 390 P/LC ±, 391 P/LC ±, 392 P/LC ±, 393 P/LC ±, 394 P/LC ±, 395 P/LC ±, 396 P/LC ±, 397 P/LC ±, 398 P/LC ±, 399 P/LC ±, 400 P/LC ±, 401 P/LC ±, 402 P/LC ±, 403 P/LC ±, 404 P/LC ±, 405 P/LC ±, 406 P/LC ±, 407 P/LC ±, 408 P/LC ±, 409 P/LC ±, 410 P/LC ±, 411 P/LC ±, 412 P/LC ±, 413 P/LC ±, 414 P/LC ±, 415 P/LC ±, 416 P/LC ±, 417 P/LC ±, 418 P/LC ±, 419 P/LC ±, 420 P/LC ±, 421 P/LC ±, 422 P/LC ±, 423 P/LC ±, 424 P/LC ±, 425 P/LC ±, 426 P/LC ±, 427 P/LC ±, 428 P/LC ±, 429 P/LC ±, 430 P/LC ±, 431 P/LC ±, 432 P/LC ±, 433 P/LC ±, 434 P/LC ±, 435 P/LC ±, 436 P/LC ±, 437 P/LC ±, 438 P/LC ±, 439 P/LC ±, 440 P/LC ±, 441 P/LC ±, 442 P/LC ±, 443 P/LC ±, 444 P/LC ±, 445 P/LC ±, 446 P/LC ±, 447 P/LC ±, 448 P/LC ±, 449 P/LC ±, 450 P/LC ±, 451 P/LC ±, 452 P/LC ±, 453 P/LC ±, 454 P/LC ±, 455 P/LC ±, 456 P/LC ±, 457 P/LC ±, 458 P/LC ±, 459 P/LC ±, 460 P/LC ±, 461 P/LC ±, 462 P/LC ±, 463 P/LC ±, 464 P/LC ±, 465 P/LC ±, 466 P/LC ±, 467 P/LC ±, 468 P/LC ±, 469 P/LC ±, 470 P/LC ±, 471 P/LC ±, 472 P/LC ±, 473 P/LC ±, 474 P/LC ±, 475 P/LC ±, 476 P/LC ±, 477 P/LC ±, 478 P/LC ±, 479 P/LC ±, 480 P/LC ±, 481 P/LC ±, 482 P/LC ±, 483 P/LC ±, 484 P/LC ±, 485 P/LC ±, 486 P/LC ±, 487 P/LC ±, 488 P/LC ±, 489 P/LC ±, 490 P/LC ±, 491 P/LC ±, 492 P/LC ±, 493 P/LC ±, 494 P/LC ±, 495 P/LC ±, 496 P/LC ±, 497 P/LC ±, 498 P/LC ±, 499 P/LC ±, 500 P/LC ±, 501 P/LC ±, 502 P/LC ±, 503 P/LC ±, 504 P/LC ±, 505 P/LC ±, 506 P/LC ±, 507 P/LC ±, 508 P/LC ±, 509 P/LC ±, 510 P/LC ±, 511 P/LC ±, 512 P/LC ±, 513 P/LC ±, 514 P/LC ±, 515 P/LC ±, 516 P/LC ±, 517 P/LC ±, 518 P/LC ±, 519 P/LC ±, 520 P/LC ±, 521 P/LC ±, 522 P/LC ±, 523 P/LC ±, 524 P/LC ±, 525 P/LC ±, 526 P/LC ±, 527 P/LC ±, 528 P/LC ±, 529 P/LC ±, 530 P/LC ±, 531 P/LC ±, 532 P/LC ±, 533 P/LC ±, 534 P/LC ±, 535 P/LC ±, 536 P/LC ±, 537 P/LC ±, 538 P/LC ±, 539 P/LC ±, 540 P/LC ±, 541 P/LC ±, 542 P/LC ±, 543 P/LC ±, 544 P/LC ±, 545 P/LC ±, 546 P/LC ±, 547 P/LC ±, 548 P/LC ±, 549 P/LC ±, 550 P/LC ±, 551 P/LC ±, 552 P/LC ±, 553 P/LC ±, 554 P/LC ±, 555 P/LC ±, 556 P/LC ±, 557 P/LC ±, 558 P/LC ±, 559 P/LC ±, 560 P/LC ±, 561 P/LC ±, 562 P/LC ±, 563 P/LC ±, 564 P/LC ±, 565 P/LC ±, 566 P/LC ±, 567 P/LC ±, 568 P/LC ±, 569 P/LC ±, 570 P/LC ±, 571 P/LC ±, 572 P/LC ±, 573 P/LC ±, 574 P/LC ±, 575 P/LC ±, 576 P/LC ±, 577 P/LC ±, 578 P/LC ±, 579 P/LC ±, 580 P/LC ±, 581 P/LC ±, 582 P/LC ±, 583 P/LC ±, 584 P/LC ±, 585 P/LC ±, 586 P/LC ±, 587 P/LC ±, 588 P/LC ±, 589 P/LC ±, 590 P/LC ±, 591 P/LC ±, 592 P/LC ±, 593 P/LC ±, 594 P/LC ±, 595 P/LC ±, 596 P/LC ±, 597 P/LC ±, 598 P/LC ±, 599 P/LC ±, 600 P/LC ±, 601 P/LC ±, 602 P/LC ±, 603 P/LC ±, 604 P/LC ±, 605 P/LC ±, 606 P/LC ±, 607 P/LC ±, 608 P/LC ±, 609 P/LC ±, 610 P/LC ±, 611 P/LC ±, 612 P/LC ±, 613 P/LC ±, 614 P/LC ±, 615 P/LC ±, 616 P/LC ±, 617 P/LC ±, 618 P/LC ±, 619 P/LC ±, 620 P/LC ±, 621 P/LC ±, 622 P/LC ±, 623 P/LC ±, 624 P/LC ±, 625 P/LC ±, 626 P/LC ±, 627 P/LC ±, 628 P/LC ±, 629 P/LC ±, 630 P/LC ±, 631 P/LC ±, 632 P/LC ±, 633 P/LC ±, 634 P/LC ±, 635 P/LC ±, 636 P/LC ±, 637 P/LC ±, 638 P/LC ±, 639 P/LC ±, 640 P/LC ±, 641 P/LC ±, 642 P/LC ±, 643 P/LC ±, 644 P/LC ±, 645 P/LC ±, 646 P/LC ±, 647 P/LC ±, 648 P/LC ±, 649 P/LC ±, 650 P/LC ±, 651 P/LC ±, 652 P/LC ±, 653 P/LC ±, 654 P/LC ±, 655 P/LC ±, 656 P/LC ±, 657 P/LC ±, 658 P/LC ±, 659 P/LC ±, 660 P/LC ±, 661 P/LC ±, 662 P/LC ±, 663 P/LC ±, 664 P/LC ±, 665 P/LC ±, 666 P/LC ±, 667 P/LC ±, 668 P/LC ±, 669 P/LC ±, 670 P/LC ±, 671 P/LC ±, 672 P/LC ±, 673 P/LC ±, 674 P/LC ±, 675 P/LC ±, 676 P/LC ±, 677 P/LC ±, 678 P/LC ±, 679 P/LC ±, 680 P/LC ±, 681 P/LC ±, 682 P/LC ±, 683 P/LC ±, 684 P/LC ±, 685 P/LC ±, 686 P/LC ±, 687 P/LC ±, 688 P/LC ±, 689 P/LC ±, 690 P/LC ±, 691 P/LC ±, 692 P/LC ±, 693 P/LC ±, 694 P/LC ±, 695 P/LC ±, 696 P/LC ±, 697 P/LC ±, 698 P/LC ±, 699 P/LC ±, 700 P/LC ±, 701 P/LC ±, 702 P/LC ±, 703 P/LC ±, 704 P/LC ±, 705 P/LC ±, 706 P/LC ±, 707 P/LC ±, 708 P/LC ±, 709 P/LC ±, 710 P/LC ±, 711 P/LC ±, 712 P/LC ±, 713 P/LC ±, 714 P/LC ±, 715 P/LC ±, 716 P/LC ±, 717 P/LC ±, 718 P/LC ±, 719 P/LC ±, 720 P/LC ±, 721 P/LC ±, 722 P/LC ±, 723 P/LC ±, 724 P/LC ±, 725 P/LC ±, 726 P/LC ±, 727 P/LC ±, 728 P/LC ±, 729 P/LC ±, 730 P/LC ±, 731 P/LC ±, 732 P/LC ±, 733 P/LC ±, 734 P/LC ±, 735 P/LC ±, 736 P/LC ±, 737 P/LC ±, 738 P/LC ±, 739 P/LC ±, 740 P/LC ±, 741 P/LC ±, 742 P/LC ±, 743 P/LC ±, 744 P/LC ±, 745 P/LC ±, 746 P/LC ±, 747 P/LC ±, 748 P/LC ±, 749 P/LC ±, 750 P/LC ±, 751 P/LC ±, 752 P/LC ±, 753 P/LC ±, 754 P/LC ±, 755 P/LC ±, 756 P/LC ±, 757 P/LC ±, 758 P/LC ±, 759 P/LC ±, 760 P/LC ±, 761 P/LC ±, 762 P/LC ±, 763 P/LC ±, 764 P/LC ±, 765 P/LC ±, 766 P/LC ±, 767 P/LC ±, 768 P/LC ±, 769 P/LC ±, 770 P/LC ±, 771 P/LC ±, 772 P/LC ±, 773 P/LC ±, 774 P/LC ±, 775 P/LC ±, 776 P/LC ±, 777 P/LC ±, 778 P/LC ±, 779 P/LC ±, 780 P/LC ±, 781 P/LC ±, 782 P/LC ±, 783 P/LC ±, 784 P/LC ±, 785 P/LC ±, 786 P/LC ±, 787 P/LC ±, 788 P/LC ±, 789 P/LC ±, 790 P/LC ±, 791 P/LC ±, 792 P/LC ±, 793 P/LC ±, 794 P/LC ±, 795 P/LC ±, 796 P/LC ±, 797 P/LC ±, 798 P/LC ±, 799 P/LC ±, 800 P/LC ±, 801 P/LC ±, 802 P/LC ±, 803 P/LC ±, 804 P/LC ±, 805 P/LC ±, 806 P/LC ±, 807 P/LC ±, 808 P/LC ±, 809 P/LC ±, 810 P/LC ±, 811 P/LC ±, 812 P/LC ±, 813 P/LC ±, 814 P/LC ±, 815 P/LC ±, 816 P/LC ±, 817 P/LC ±, 818 P/LC ±, 819 P/LC ±, 820 P/LC ±, 821 P/LC ±, 822 P/LC ±, 823 P/LC ±, 824 P/LC ±, 825 P/LC ±, 826 P/LC ±, 827 P/LC ±, 828 P/LC ±, 829 P/LC ±, 830 P/LC ±, 831 P/LC ±, 832 P/LC ±, 833 P/LC ±, 834 P/LC ±, 835 P/LC ±, 836 P/LC ±, 837 P/LC ±, 838 P/LC ±, 839 P/LC ±, 840 P/LC ±, 841 P/LC ±, 842 P/LC ±, 843 P/LC ±, 844 P/LC ±, 845 P/LC ±, 846 P/LC ±, 847 P/LC ±, 848 P/LC ±, 849 P/LC ±, 850 P/LC ±, 851 P/LC ±, 852 P/LC ±, 853 P/LC ±, 854 P/LC ±, 855 P/LC ±, 856 P/LC ±, 857 P/LC ±, 858 P/LC ±, 859 P/LC ±, 860 P/LC ±, 861 P/LC ±, 862 P/LC ±, 863 P/LC ±, 864 P/LC ±, 865 P/LC ±, 866 P/LC ±, 867 P/LC ±, 868 P/LC ±, 869 P/LC ±, 870 P/LC ±, 871 P/LC ±, 872 P/LC ±, 873 P/LC ±, 874 P/LC ±, 875 P/LC ±, 876 P/LC ±, 877 P/LC ±, 878 P/LC ±, 879 P/LC ±, 880 P/LC ±, 881 P/LC ±, 882 P/LC ±, 883 P/LC ±, 884 P/LC ±, 885 P/LC ±, 886 P/LC ±, 887 P/LC ±, 888 P/LC ±, 889 P/LC ±, 890 P/LC ±, 891 P/LC ±, 892 P/LC ±, 893 P/LC ±, 894 P/LC ±, 895 P/LC ±, 896 P/LC ±, 897 P/LC ±, 898 P/LC ±, 899 P/LC ±, 900 P/LC ±, 901 P/LC ±, 902 P/LC ±, 903 P/LC ±, 904 P/LC ±, 905 P/LC ±, 906 P/LC ±, 907 P/LC ±, 908 P/LC ±, 909 P/LC ±, 910 P/LC ±, 911 P/LC ±, 912 P/LC ±, 913 P/LC ±, 914 P/LC ±, 915 P/LC ±, 916 P/LC ±, 917 P/LC ±, 918 P/LC ±, 919 P/LC ±, 920 P/LC ±, 921 P/LC ±, 922 P/LC ±, 923 P/LC ±, 924 P/LC ±, 925 P/LC ±, 926 P/LC ±, 927 P/LC ±, 928 P/LC ±, 929 P/LC ±, 930 P/LC ±, 931 P/LC ±, 932 P/LC ±, 933 P/LC ±, 934 P/LC ±, 935 P/LC ±, 936 P/LC ±, 937 P/LC ±, 938 P/LC ±, 939 P/LC ±, 940 P/LC ±, 941 P/LC ±, 942 P/LC ±, 943 P/LC ±, 944 P/LC ±, 945 P/LC ±, 946 P/LC ±, 947 P/LC ±, 948 P/LC ±, 949 P/LC ±, 950 P/LC ±, 951 P/LC ±, 952 P/LC ±, 953 P/LC ±, 954 P/LC ±, 955 P/LC ±, 956 P/LC ±, 957 P/LC ±, 958 P/LC ±, 959 P/LC ±, 960 P/LC ±, 961 P/LC ±, 962 P/LC ±, 963 P/LC ±, 964 P/LC ±, 965 P/LC ±, 966 P/LC ±, 967 P/LC ±, 968 P/LC ±, 969 P/LC ±, 970 P/LC ±, 971 P/LC ±, 972 P/LC ±, 973 P/LC ±, 974 P/LC ±, 975 P/LC ±, 976 P/LC ±, 977 P/LC ±, 978 P/LC ±, 979 P/LC ±, 980 P/LC ±, 981 P/LC ±, 982 P/LC ±, 983 P/LC ±, 984 P/LC ±, 985 P/LC ±, 986 P/LC ±, 987 P/LC ±, 988 P/LC ±, 989 P/LC ±, 990 P/LC ±, 991 P/LC ±, 992 P/LC ±, 993 P/LC ±, 994 P/LC ±, 995 P/LC ±, 996 P/LC ±, 997 P/LC ±, 998 P/LC ±, 999 P/LC ±, 1000 P/LC ±.

TYCO Electronics Corporation
Harrisburg, PA 17105-3608

CABLE ASSEMBLY, MOD PLUG, 8 POSITION,
YELLOW, ENHANCED CATEGORY 5

SIZE: 108-1163
APPLICATION SPEC: 114-6053
WEIGHT: -
FINISH: -

CAGE CODE: A2 00779
DRAWING NO: 219246

CUSTOMER DRAWING

SCALE: 1 of 1
SHEET: 1 of 1
REV: F